

E13 PROVIDE A DUPLEX RECEPTACLE AND (2) 2" IN WALL TO ABOVE CEILING FOR WALL MOUNTED TELEPHONE / DATA CABINET. COORDINATE EXACT LOCATION WITH OWNER PRIOR TO ROUGH IN.


E14 ALL EXTERIOR DOORS NOT INDICATED TO BE PROVIDED WITH A CARD READER SHALL HAVE A 1/2" CONDUIT FROM THE DOOR JAMB TO ABOVE ACCESSIBLE CEILING FOR DOOR CONTACTS. THIS REQUIREMENT IS FOR ALL EXTERIOR DOORS ON THE ENTIRE BUILDING THAT DO NOT HAVE CARD READERS.

P+A PURTLE + ASSOCIATES CONSULTING ENGINEERS 9441 STEVENS RD, SUITE 200 SHREVEPORT, LOUISIANA 71106	PROJECT NAME GILMER ISD NEW HIGH SCHOOL	PROJECT # PA-18234	DATE 05-17-2019
	SHEET TITLE FIRST FLOOR PLAN - AREA C - POWER	PR # 12	SHEET PR12E1
		SHEET REFERENCE E1.2	SCALE 1/8" = 1'-0"

THIS DOCUMENT IS THE PROPERTY OF PURTLE + ASSOCIATES. IT IS TO BE USED ONLY FOR THE PROJECT IDENTIFIED AND NOT BE LOANED, REPRODUCED, COPIED, OR IN ANY MANNER USED FOR ANY OTHER PROJECT OR AT ANY OTHER LOCATION WITHOUT THE EXPRESS WRITTEN APPROVAL AND PARTICIPATION OF PURTLE + ASSOCIATES, L.P. VIOLATION OF THESE CONDITIONS OF ANY PART, PART, DETAIL, ETC. MAY BE AUTHORISED BY PURTLE + ASSOCIATES, L.P. ALL RIGHTS ARE RESERVED TO PURTLE + ASSOCIATES, L.P.

12x12 J-BOX. MOUNT J-BOX ABOVE NEAREST LAY-IN CEILING.

TO NEAREST 120V UNSWITCHED RECEPTACLE CIRCUIT PROVIDE #16/2 WIRE TO A PUSHBUTTON IN RECEPTION

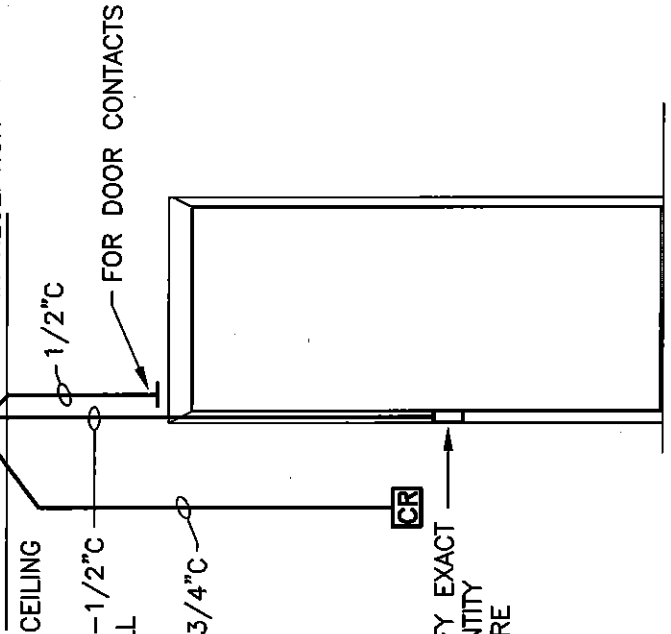

DOOR STRIKE (VERIFY EXACT LOCATION AND QUANTITY WITH ARCH HARDWARE SPECIFICATIONS)

B SECURE ENTRY DOOR ELEVATION -
SECURITY ROUGH-IN
 NO SCALE



PROJECT #	DATE
PA-18234	05-17-2019
PR #	SHEET
12	PR12E2
SHEET REFERENCE	SCALE
E3.1	NO SCALE

PROJECT NAME	GILMER ISD NEW HIGH SCHOOL
SHEET TITLE	ELECTRICAL DETAILS
P+A PURTLE + ASSOCIATES CONSULTING ENGINEERS 9441 STEVENS RD., SUITE 200 SHREVEPORT, LOUISIANA 71106 318 425 4500 318 222 6564 fax purtle@purtle.net Texas Registered Engineering Firm #F-10120	<small> THESE DOCUMENTS ARE PROTECTED BY UNITED STATES COPYRIGHT LAW. THEY HAVE BEEN PREPARED SPECIFICALLY FOR THE PROJECT IDENTIFIED AND ARE NOT AVAILABLE FOR REUSE ON ANY OTHER PROJECT OR AT ANY OTHER LOCATION WITHOUT THE EXPRESS WRITTEN APPROVAL AND PARTICIPATION OF PURTLE AND ASSOCIATES, L.L.C. REPRODUCTION OF THESE DOCUMENTS OR ANY PART, PARTIAL DETAILS ETC. MUST BE AUTHORIZED BY PURTLE AND ASSOCIATES, L.L.C. </small>

